


EDGE METAL - ISO VIEW

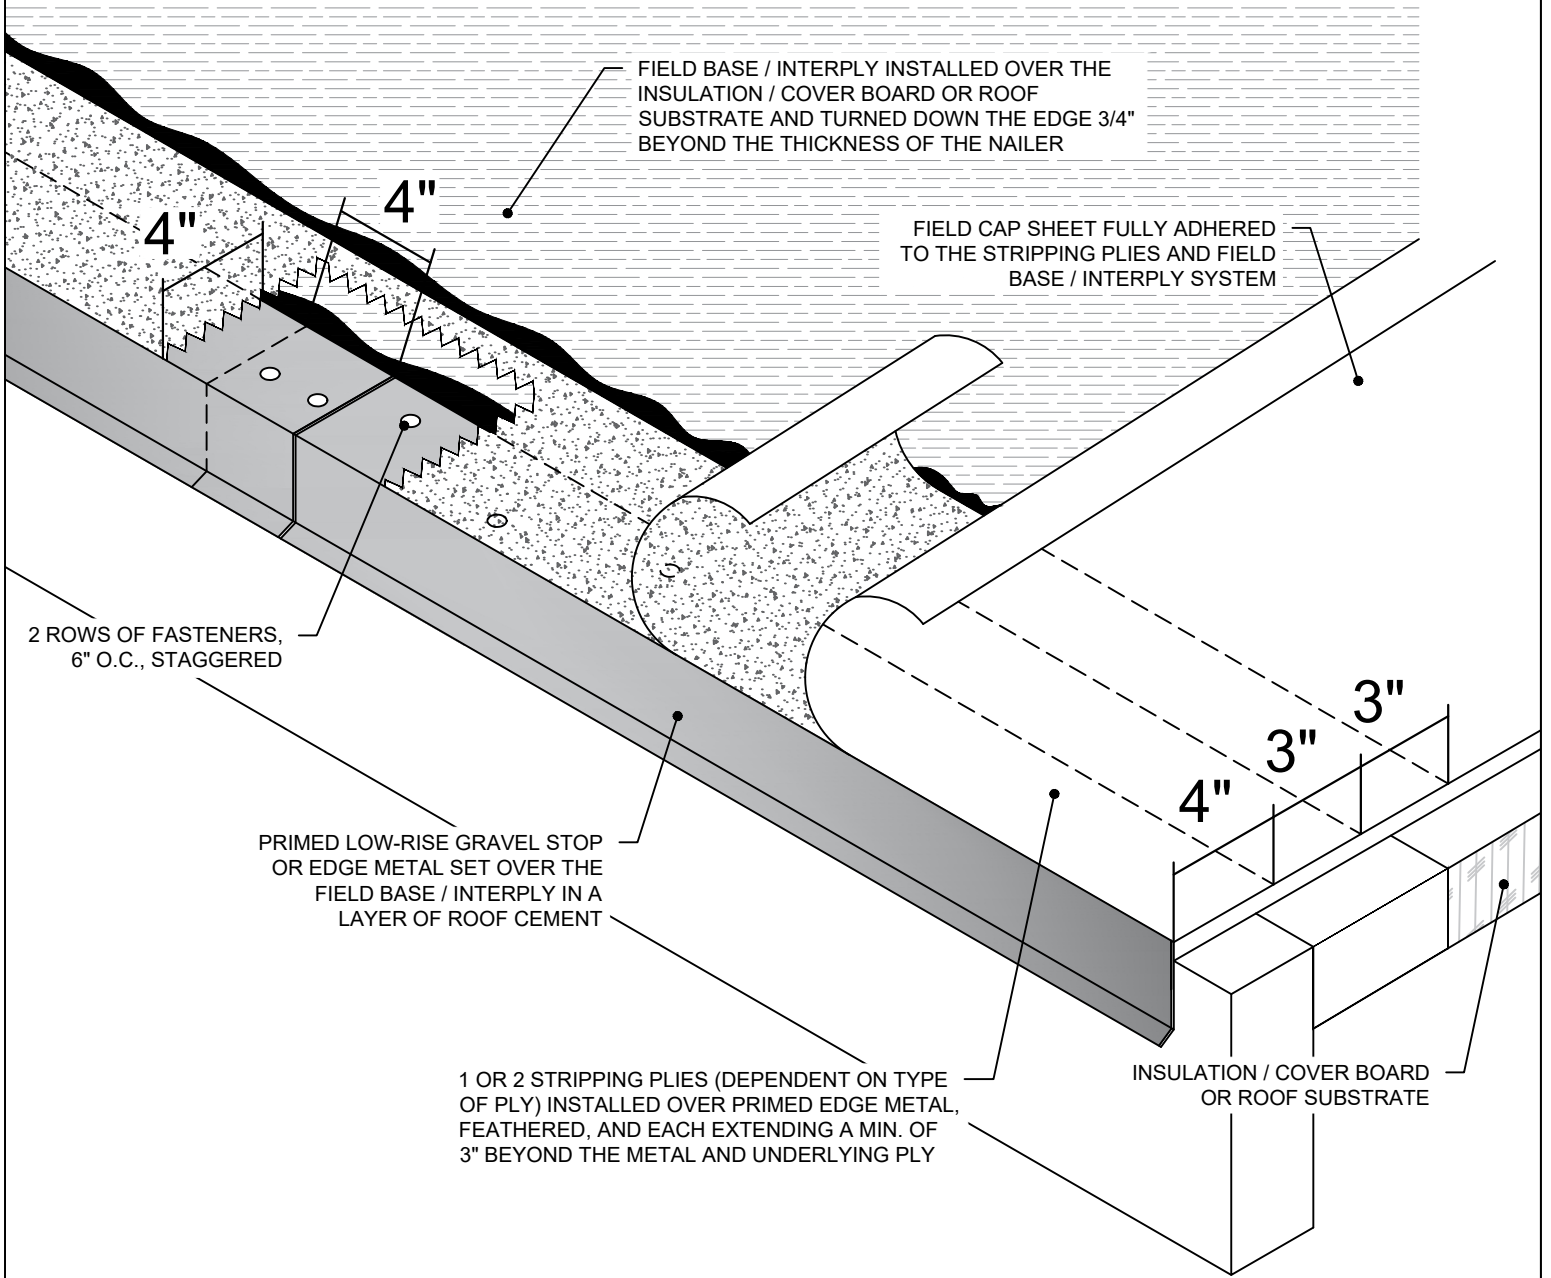

FIELD BASE / INTERPLY INSTALLED OVER THE INSULATION / COVER BOARD OR ROOF SUBSTRATE AND TURNED DOWN THE EDGE 3/4" BEYOND THE THICKNESS OF THE NAILER

FIELD CAP SHEET FULLY ADHERED TO THE STRIPPING PLIES AND FIELD BASE / INTERPLY SYSTEM

2 ROWS OF FASTENERS, 6" O.C., STAGGERED

PRIMED LOW-RISE GRAVEL STOP OR EDGE METAL SET OVER THE FIELD BASE / INTERPLY IN A LAYER OF ROOF CEMENT


1 OR 2 STRIPPING PLIES (DEPENDENT ON TYPE OF PLY) INSTALLED OVER PRIMED EDGE METAL, FEATHERED, AND EACH EXTENDING A MIN. OF 3" BEYOND THE METAL AND UNDERLYING PLY

INSULATION / COVER BOARD OR ROOF SUBSTRATE

NOTES:

1. WHEN INSTALLING WITH INSULATION AND/OR COVER BOARD, WOOD NAILER MUST BE INSTALLED AT ROOF EDGE, MATCHING THE HEIGHT OF INSULATION / COVER BOARD AND EXTENDING PAST FLANGE OF METAL.
2. LAP EDGE METAL A MINIMUM OF 4"; INSTALL SEALANT IN THE LAP AND FASTEN.

LOW SLOPE 17 - ISO

	PROJECT NAME:	DATE:
	ADDRESS:	SCALE: NOT TO SCALE
		PROJECT NO:
	OWNER:	DRAWING NO. :
Rev. 2/21		SUBMITTAL NO. :