


PIPE FLASHING LAMINATE SHINGLE ROOF

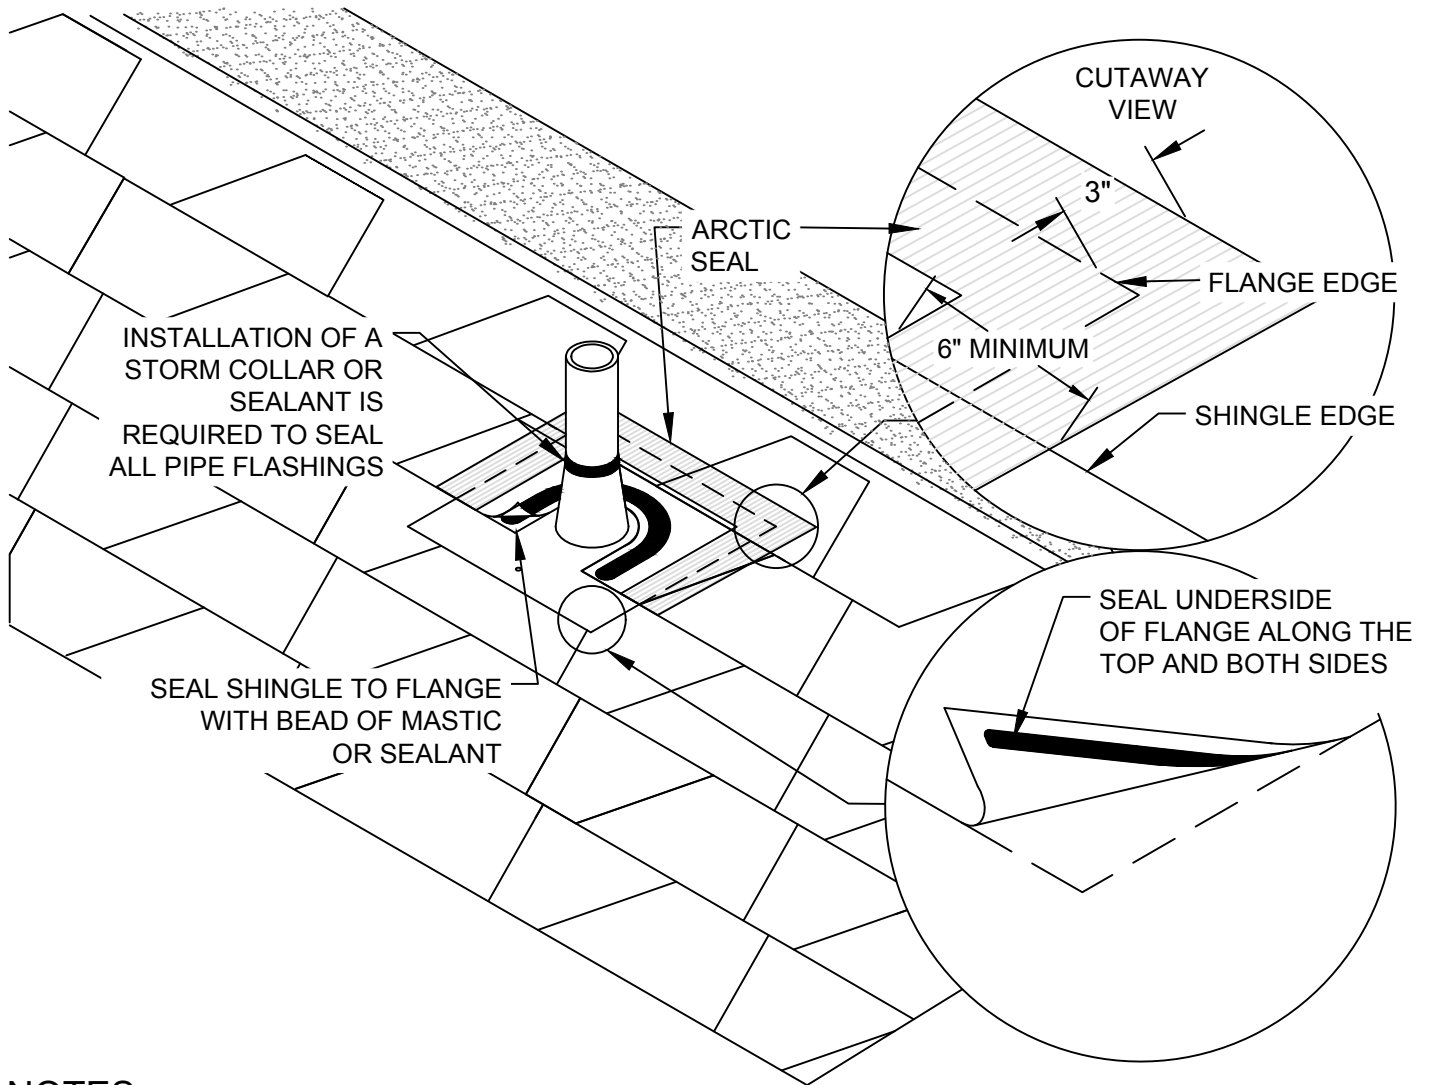

NOTES:

- FOR ADDITIONAL PROTECTION ON SLOPES 2" - 4" MALARKEY RECOMMENDS THE UNEXPOSED FLANGES OF ALL VENT AND PIPE FLASHINGS BE STRIPPED-OFF (MINIMUM 6" WIDE) WITH ARCTIC SEAL SELF-ADHERING UNDERLAYMENT COVERING ALL FASTENERS USED TO SECURE THE FLASHINGS AND TYING ONTO THE FIELD UNDERLAYMENT A MINIMUM OF 3".
- SHINGLES ON TOP OF THE STRIPPING OF ARCTIC SEAL SHOULD BE SEALED DOWN WITH A BEAD OF MASTIC/SEALANT (UNEXPOSED/UNDER THE SHINGLES).

STEEP SLOPE 18B



Rev. 1/17

PROJECT NAME:

ADDRESS:

OWNER:

DATE:

SCALE: NOT TO SCALE

PROJECT NO:

DRAWING NO. :

SUBMITTAL NO. :