



PIPE FLASHING WINDSOR SHINGLE ROOF

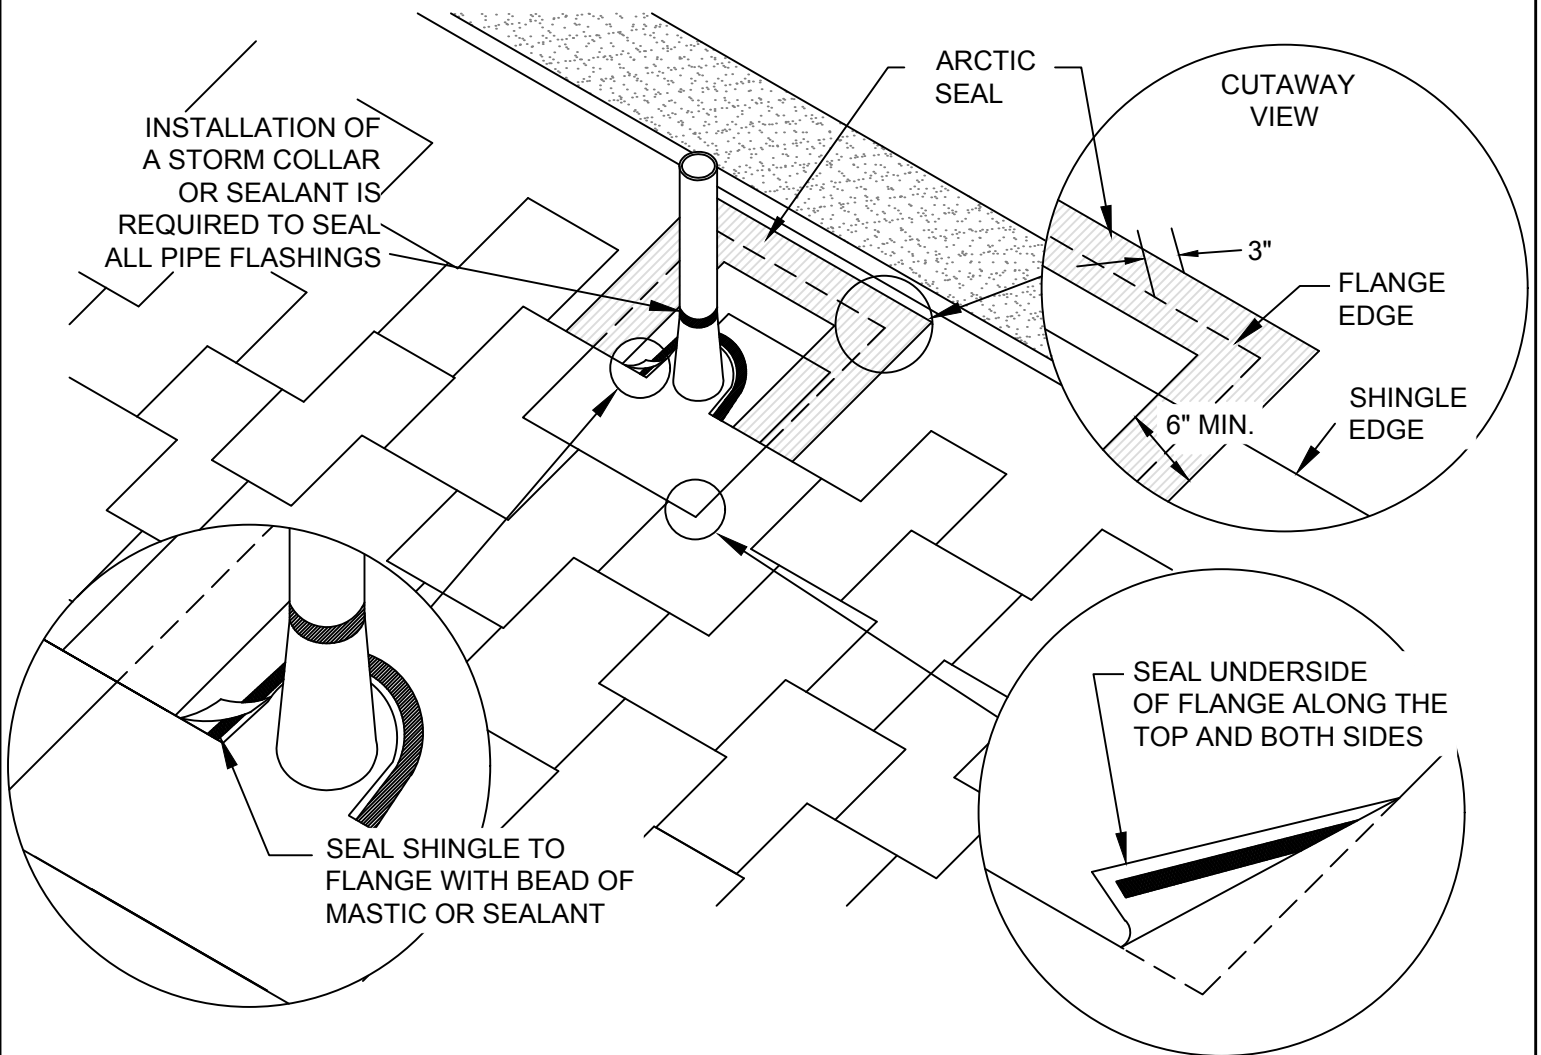

NOTES:

- FOR ADDITIONAL PROTECTION ON SLOPES 2" - 4" MALARKEY RECOMMENDS THE UNEXPOSED FLANGES OF ALL VENT AND PIPE FLASHINGS BE STRIPPED-OFF (MINIMUM 6" WIDE) WITH ARCTIC SEAL SELF-ADHERING UNDERLAYMENT COVERING ALL FASTENERS USED TO SECURE THE FLASHINGS AND TYING ONTO THE FIELD UNDERLAYMENT A MINIMUM OF 3".
- SHINGLES ON TOP OF THE STRIPPING OF ARCTIC SEAL SHOULD BE SEALED DOWN WITH A BEAD OF MASTIC/SEALANT (UNEXPOSED/UNDER THE SHINGLES).

STEEP SLOPE 18C

 <p>Malarkey Roofing Products® Defining Excellence.™</p>	PROJECT NAME:	DATE:
		SCALE: NOT TO SCALE
	ADDRESS:	PROJECT NO:
		DRAWING NO. :
OWNER:		SUBMITTAL NO. :